



## WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTERS

Pursuant to the requirements of the Washington State Department of Health to protect public health and safety, the Lake Chelan Reclamation District (LCRD) requires all customers receiving potable water from the District's water distribution system to comply with all applicable state and local regulations mandating approved backflow prevention assemblies.

In accordance with these regulations, and to safeguard the LCRD water system and public health, approved backflow prevention assemblies must be properly installed, maintained, and tested annually by a licensed and certified Backflow Assembly Tester. All costs and liability associated with the installation, maintenance, and testing of these assemblies shall be the sole responsibility of the customer.

Customers are responsible for verifying the credentials and certification status of any backflow assembly tester they engage and for entering into any required testing and inspection agreements necessary to ensure full compliance with the District's Cross-Connection Control regulations.

All test results should be emailed to [BACKFLOW@LCRD.ORG](mailto:BACKFLOW@LCRD.ORG)

*The District takes no position in regard to recommendation or endorsement of those listed.*

### ***CHELAN BACKFLOW***

Jeff Field, #B6479  
Brian Slater, #B6664  
Wes Field, #B6686  
Jordan Lehman, #B8015  
Phone: (509) 630-0021  
[chelanbackflow@gmail.com](mailto:chelanbackflow@gmail.com)

### ***J M WATERWORKS***

Julia A. McWiggins, #B4743  
Natalie Michael, #B7647  
Phone: (509) 860-2553  
[julie@jmwh2o.com](mailto:julie@jmwh2o.com)

### ***D&B BACKFLOW LLC***

Brian McDaniel, #B2395  
[dbackflow@gmail.com](mailto:dbackflow@gmail.com)  
Phone: (509) 679-3264

### ***1<sup>st</sup> CHOICE TESTING***

Kyle North, #B7567  
Phone: (425) 273-3106  
[office@1stchoicetesting.com](mailto:office@1stchoicetesting.com)

### ***PLUMBCO, INC***

Ernie Reynolds, #B6792  
Daniel Dobbins, #B7405  
Brock Chapman, #B7194  
Phone: (509) 662-0180  
[office@plumbcoinc.net](mailto:office@plumbcoinc.net)

### ***BACKFLOWS NORTHWEST***


Christopher Sutton, #B5225  
Sean Lyon, #B7807  
Phone: (509) 847-8705  
[www.backflownorthwest.com](http://www.backflownorthwest.com)  
[office@backflownorthwest.com](mailto:office@backflownorthwest.com)

### ***H2O CONNECTIONS NW***

Jason Williams, #B6144  
Phone: (509) 885-6920  
[h2oconnections nw@yahoo.com](mailto:h2oconnections nw@yahoo.com)

### ***PLUMB PERFECT***

Cameron Bruggman, #B6498  
Phone: (509) 663-3602  
[cameron@plumbperfectwenatchee.com](mailto:cameron@plumbperfectwenatchee.com)

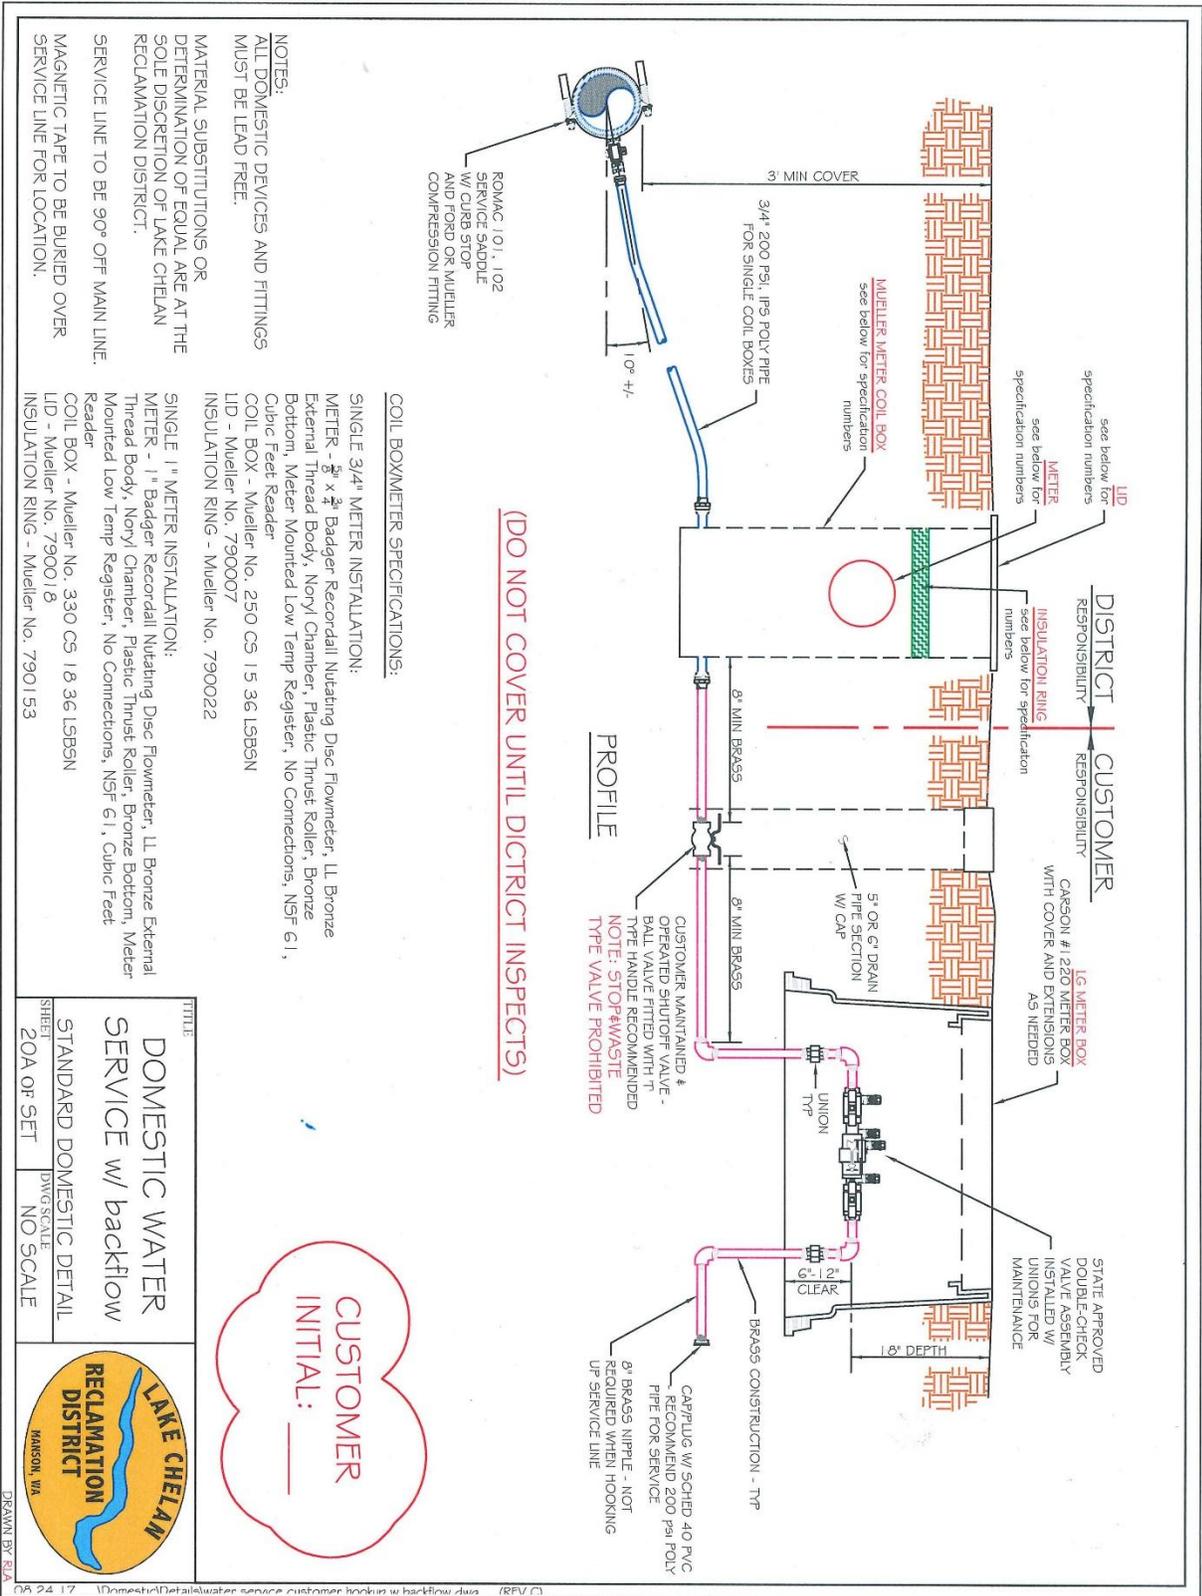

**(DO NOT COVER UNTIL DISTRICT INSPECTS)**

**COIL BOX/METER SPECIFICATIONS:**

- SINGLE 3/4" METER INSTALLATION:**  
 METER - 3/4" x 3/4" Badger Recordall Nutating Disc Flowmeter, LL Bronze External Thread Body, Noryl Chamber, Plastic Thrust Roller, Bronze Bottom, Meter Mounted Low Temp Register, No Connections, NSF 61, Cubic Feet Reader  
 COIL BOX - Mueller No. 250 CS 1 5 36 LBSBN  
 LID - Mueller No. 790007  
 INSULATION RING - Mueller No. 790022

**SINGLE 1" METER INSTALLATION:**


- METER - 1" Badger Recordall Nutating Disc Flowmeter, LL Bronze External Thread Body, Noryl Chamber, Plastic Thrust Roller, Bronze Bottom, Meter Mounted Low Temp Register, No Connections, NSF 61, Cubic Feet Reader  
 COIL BOX - Mueller No. 330 CS 1 8 36 LBSBN  
 LID - Mueller No. 790018  
 INSULATION RING - Mueller No. 790153

**NOTES:**

- ALL DOMESTIC DEVICES AND FITTINGS MUST BE LEAD FREE.
- MATERIAL SUBSTITUTIONS OR DETERMINATION OF EQUAL ARE AT THE SOLE DISCRETION OF LAKE CHELAN RECLAMATION DISTRICT.
- SERVICE LINE TO BE 90° OFF MAIN LINE.
- MAGNETIC TAPE TO BE BURIED OVER SERVICE LINE FOR LOCATION.

CUSTOMER INITIAL: \_\_\_\_\_

TITLE	
DOMESTIC WATER SERVICE w/ backflow	
STANDARD DOMESTIC DETAIL	DWG SCALE
ZOA OF SET	NO SCALE



DRAWN BY RLK